



Air quality and health impacts of ESKOM's planned non-compliance with South African Minimum Emission Standards

Lauri Myllyvirta, lead analyst, Greenpeace Global Air Pollution Unit

19 March 2019

Executive Summary

Eskom is applying for wide-ranging postponements and suspensions from South Africa's Minimum Emission Standards (MES) that would allow it to operate its entire existing fleet without even rudimentary controls for three of the most dangerous pollutants emitted from coal-fired power plants: SO₂, NO_x, and mercury.

As Eskom's coal-fired power plants are among the largest sources of air pollutant emissions in South Africa and globally, the air quality and health impacts of failing to comply with the emission standards are potentially very significant.

Compared against a scenario of full compliance with the MES after the 5-year delay to 2025, excluding units set to retire by 2030, the various postponements, variations and exemptions sought by Eskom would allow the utility to emit an estimated 19 million tonnes more SO₂, 1 million tonnes more NO_x, and 190,000 tonnes of particulate matter. The failure to install SO₂ controls would increase mercury emissions over the remaining operating life of the power plants by a total of an estimated 200,000 kilograms. These estimates are based on the assumption that all units retire after 50 years of operation - a longer operating life would mean larger excess emissions.

To assess the health impacts of these excess emissions, the Greenpeace Global Air Pollution Unit carried out CALPUFF dispersion modeling closely following the methodology of the modeling used in Eskom's Cost-Benefit Analysis, with the modeling domain expanded to cover most of South Africa's population. Separate model runs were carried out for each of the 15 Eskom power stations, and contributions of SO₂, NO_x and primary PM_{2.5} emissions to ambient PM_{2.5} and NO₂ levels were isolated for each station and each pollutant. This allowed us to project the reductions in ambient air pollution levels at each location of the modeling domain over time, as emission reductions from meeting the MES or implementing Eskom's "Emission Reduction" plan are realized. The resulting avoided health impacts were projected following the Global Burden of Disease methodology for PM_{2.5} health impacts (Stanaway et al 2018) and WHO recommendations for assessing health impacts from acute NO₂ exposure (WHO 2013). The projections take into account expected population growth (UN DESA 2017) and epidemiological transition associated with improved health care and aging population (WHO 2018).

We project that, over time, the excess emissions allowed if Eskom's requests for non-compliance with the MES are fully granted will lead to the following avoidable health impacts:

- 5,600 premature deaths due to increased risk of lower respiratory infections, including in young children
- 1,500 premature deaths due to increased risk of stroke
- 1,500 premature deaths due to increased risk of death from diabetes
- 2,300 premature deaths due to increased risk of chronic obstructive pulmonary disease
- 3,000 premature deaths due to increased risk of ischaemic heart disease, and
- 1,900 premature deaths due to increased risk of lung cancer associated with chronic PM2.5 exposure, as well as
- 500 premature deaths due to increased risk of death associated with acute NO2 exposure.

In total, an estimated 16,000 premature deaths (95% confidence interval: 13,000 to 18,000 deaths) could be avoided by requiring full compliance with the MES. This represents a 40% reduction in the health impact of air pollution from Eskom's power stations.

The location of Eskom's extremely highly polluting coal-fired power plant fleet in the vicinity of the highly populated region of Gauteng, with many plants located within 100km of the region, is a particular public health concern. Eskom's coal power plant emissions are responsible for approximately 420 premature deaths (95% confidence interval 330 to 500) per year in Gauteng. These impacts break down into 140 premature deaths in Johannesburg, 120 in Tshwane, 120 in Ekurhuleni, 20 in Sedibeng and 20 in West Rand.

We project that, over the current lifetime of Eskom's coal power stations, the excess emissions allowed if Eskom's application for non-compliance with the MES are fully granted will lead to the following avoidable health impacts in Gauteng, compared with full compliance:

- 860 premature deaths due to increased risk of lower respiratory infections, including in young children
- 300 premature deaths due to increased risk of stroke
- 110 premature deaths due to increased risk of death from diabetes
- 500 premature deaths due to increased risk of chronic obstructive pulmonary disease
- 600 premature deaths due to increased risk of ischaemic heart disease, and
- 500 premature deaths due to increased risk of lung cancer associated with chronic PM2.5 exposure, as well as
- 190 premature deaths due to increased risk of death associated with acute NO2 exposure.


In total, an estimated 3,100 premature deaths (95% confidence interval: 2,600 to 3,300 deaths) could be avoided in the Gauteng region by requiring full compliance with the MES. These impacts break down into 1,000 premature deaths in Johannesburg, 900 in Tshwane, 800 in Ekurhuleni, 150 in Sedibeng and 170 in the West Rand.

Mercury deposition from the existing and new Eskom coal power plants is projected to exceed levels which can cause health risks, over an area of 89,000km², with 3.4 million inhabitants. The mercury emissions result in an estimated 2,300kg per year of mercury deposited on land and on freshwater bodies within the modeling domain. Cumulatively, the excess emissions from Eskom's proposed non-compliance would cause a projected 13,000kg of excess mercury deposition locally in South Africa.


Results

Emissions: Two scenarios are compared, a scenario of full compliance with the MES by 2025 for all units operating beyond 2030, and Eskom's so-called '*Emission Reduction Plan*', which would have emissions from all units except Kusile and Medupi exceed the MES until end-of-life, and Medupi would only comply by 2030. In the compliance scenario, units scheduled to close by 2030 are allowed to violate the MES while other units are retrofitted in 2022 to 2025 in a phased manner.

The assumption of completing the retrofits by 2025 is in line with experiences from other emerging economies: China retrofitted approximately 250 gigawatts of existing coal-fired capacity with FGD between 2005 and 2011, bringing share of capacity with SO₂ controls from 14.3% to 89.1% in six years. These installations were in response to the national emission standards introduced in 2004. Similarly, after the emission standards were updated in 2011 to levels that required selective catalytic NOx controls (SCR), these retrofits were carried out on approximately 480GW of capacity by 2015, raising penetration from 18.2% to 84.5% in four years. Now India is targeting to bring its entire coal fleet to compliance with stricter standards than the MES by 2022, requiring retrofits in much of its 220GW of operating capacity.

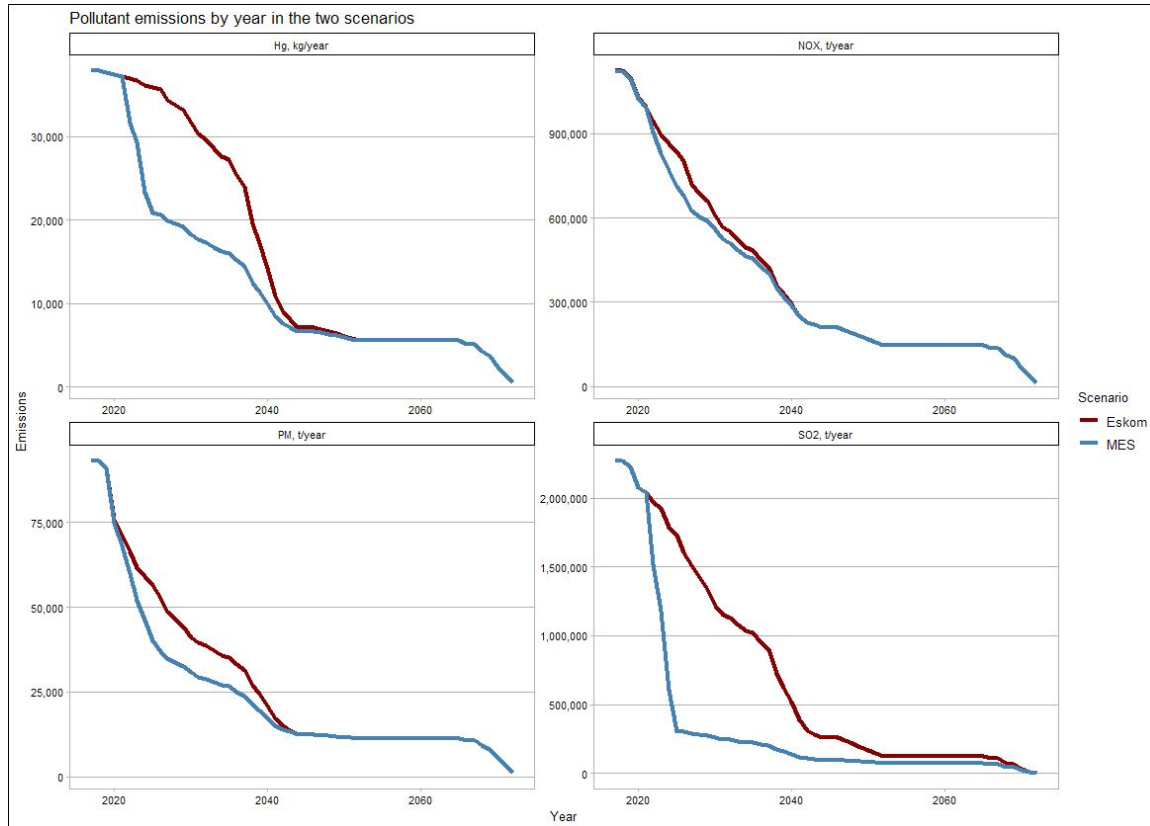

The difference in emissions between these two scenarios is the “excess emissions” allowed by Eskom’s numerous requests for postponements, alternative emission limits and exemptions.

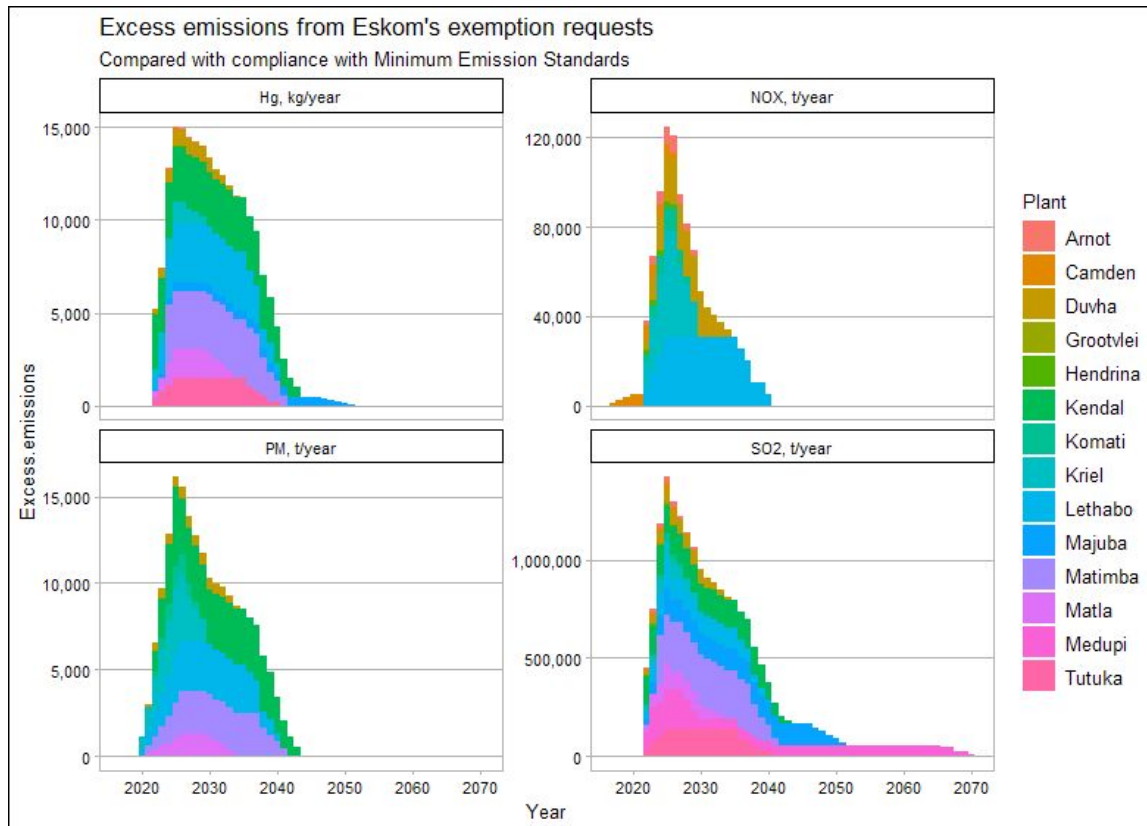

Excess SO₂ peaks at over 1 million tonnes per year, and mercury at 15,000 kilograms.

Pollutant	Eskom	MES	Excess emissions	Unit
Hg	455,000	240,000	215,000	kg
NO _x	3,570,000	2,550,000	1,020,000	t
PM	551,000	358,000	193,000	t
SO ₂	26,800,000	7,680,000	19,100,000	t

Total emissions over the remaining operating life of Eskom's fleet in different scenarios.

Air quality: the impacts of these excess emissions are estimated using the state-of-the-art CALPUFF atmospheric modeling system. This model was also used for Eskom's Cost-Benefit study, but with the major difference that the study excluded the majority of South Africa's population from the assessment of the health impacts, and most of the health impact pathways included in Global Burden of Disease and other authoritative studies, capturing only a tiny fraction of the total health impact.

The largest impact on average SO₂ and NO₂ levels occurs in the area within 10-20km of each power plant. In contrast, the impact on PM_{2.5} concentrations is much more widespread, as most of the

concentrations are due to formation of PM_{2.5} particles from SO₂ and NO_x emissions as the flue gases travel downwind. Consequently, the largest contribution to annual PM_{2.5} levels is seen downwind, to the east and southeast of the power plants, but the impact is considerable in the entire region from Limpopo to Johannesburg and Newcastle.

The modeling results indicate that emissions from Eskom power plants expose 1.6 million people to at least one exceedance of South Africa's air quality standard for 1-hour SO₂ concentration and 280,000 people to an exceedance of 1-hour NO₂ standard per year. The contributions of each plant's SO₂, NO_x and PM emissions to ambient PM_{2.5} and NO₂ emissions are quantified separately to allow calculation of health impacts under different emissions scenarios.

Toxic deposition: The mercury emissions from Eskom's power plants result in an estimated 2,300kg per year of mercury deposited on land and on freshwater bodies within the modeling domain. Cumulatively, the excess emissions from Eskom's proposed non-compliance would cause a projected 13,000kg of excess mercury deposition locally in South Africa, while the rest of the 240,000kg of excess mercury emissions would enter the global cycle.


Mercury deposition rates as low as 125mg/ha/year can lead to accumulation of unsafe levels of mercury in fish (Swain et al 1992). Eskom's emissions are estimated to cause mercury deposition above 125mg/ha/yr over an area of approximately 89,000km², with a population of 3.4 million people.

Discussion: The results, obtained using a methodology that closely mimics Eskom's own cost-benefit study, but eliminates its obvious and seemingly intentional shortcomings, show that likely health impacts of Eskom's air pollutant emissions are far larger than reported by the study.


Atmospheric modeling and health impact assessment results have considerable uncertainties, both upwards and downwards, as is apparent from the wide uncertainty ranges; however we believe the results reliably demonstrate the magnitude of the health benefits from requiring Eskom to install basic air pollution controls in its power plants.

This health impact assessment is an update of the report "Health impacts and social costs of Eskom's proposed non-compliance with South Africa's air emission standards" published in 2014 (Myllyvirta 2014). That report was reviewed, among other similar studies on health impacts of power plant emissions in South Africa, by authors from University of Johannesburg and The Nova Institute, who concluded that the study "appears to be a reasonable quantification of the health risk in remote areas, but is probably a large over-estimation of the health risk in more polluted areas," because the exposure-response relationships used "may well not be" applicable in industrialized areas due to the high overall pollution levels (Langerman&Pauw 2018). For this update of the results, the recommendations of the authors for exposure-response relationships better suited to these conditions were adopted.


Maximum 24-hour PM2.5 concentration from all Eskom coal plants

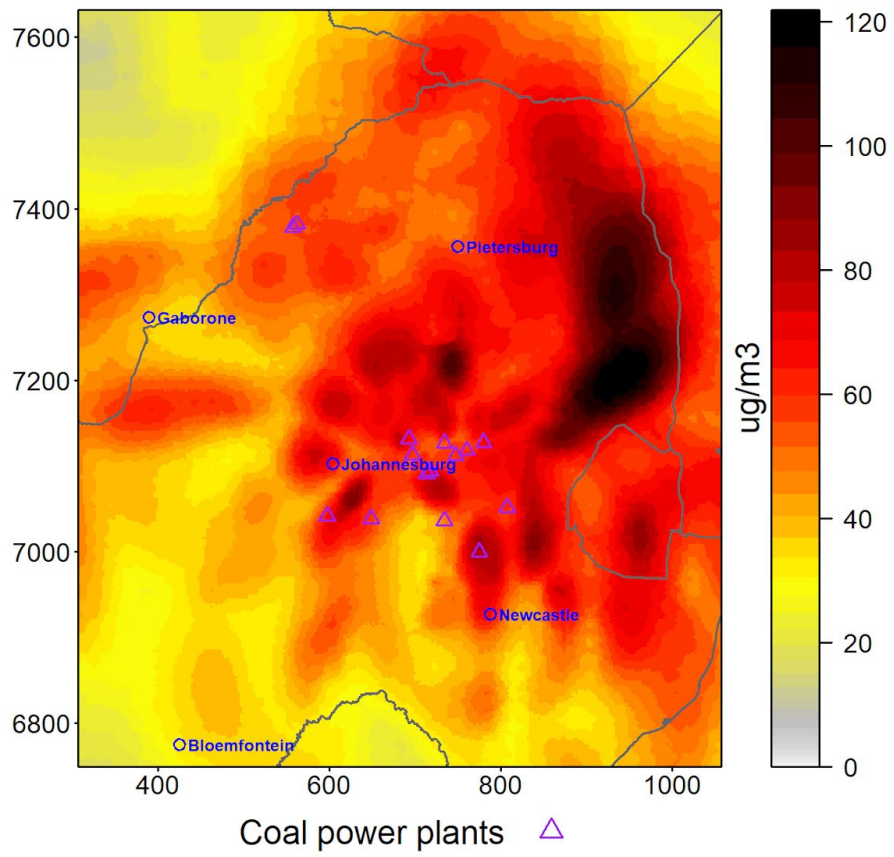


Maximum 1-hour NO₂ concentration from all Eskom coal plants

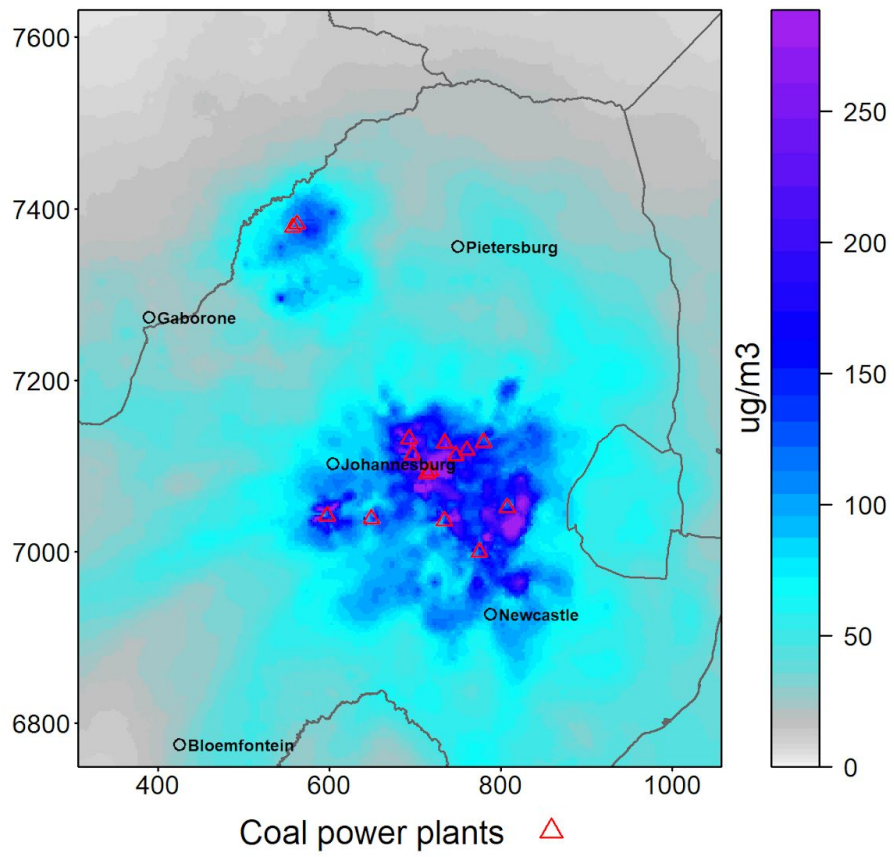


Maximum 1-hour SO₂ concentration from all Eskom coal plants

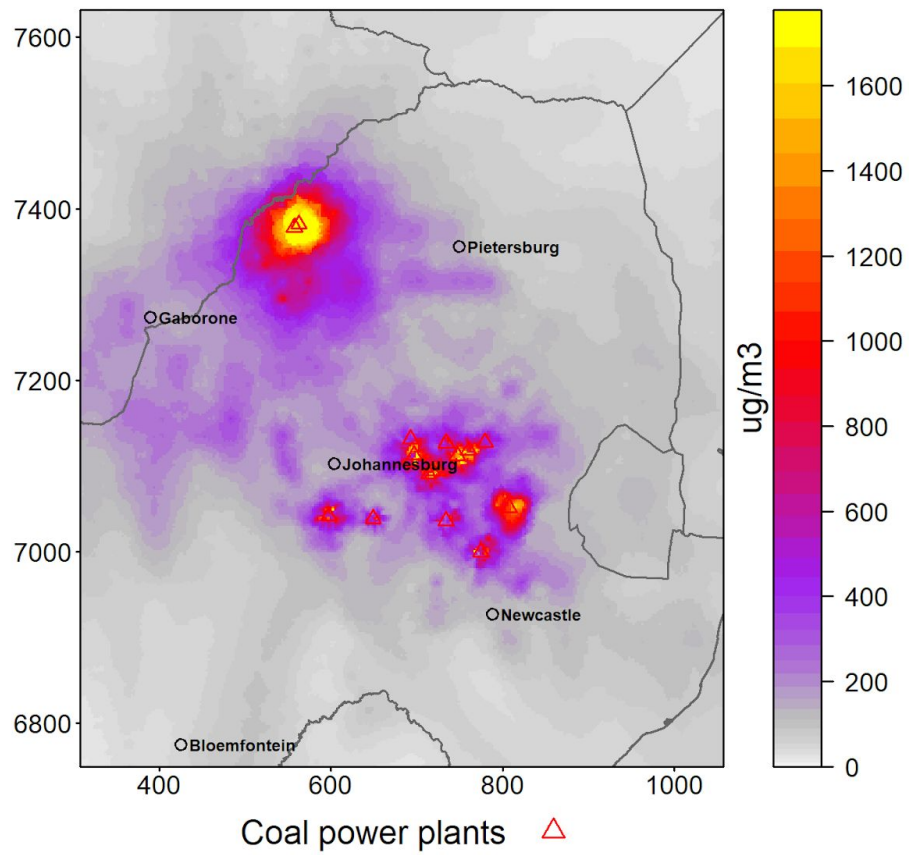


Annual mean PM2.5 concentration from all Eskom coal plants

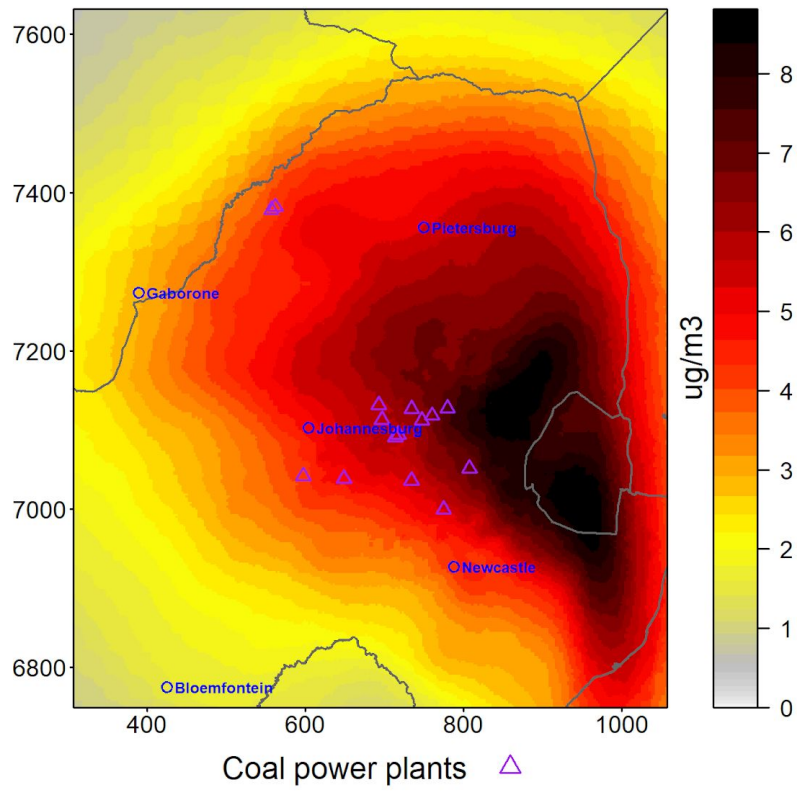

Annual mean NO₂ concentration from all Eskom coal plants

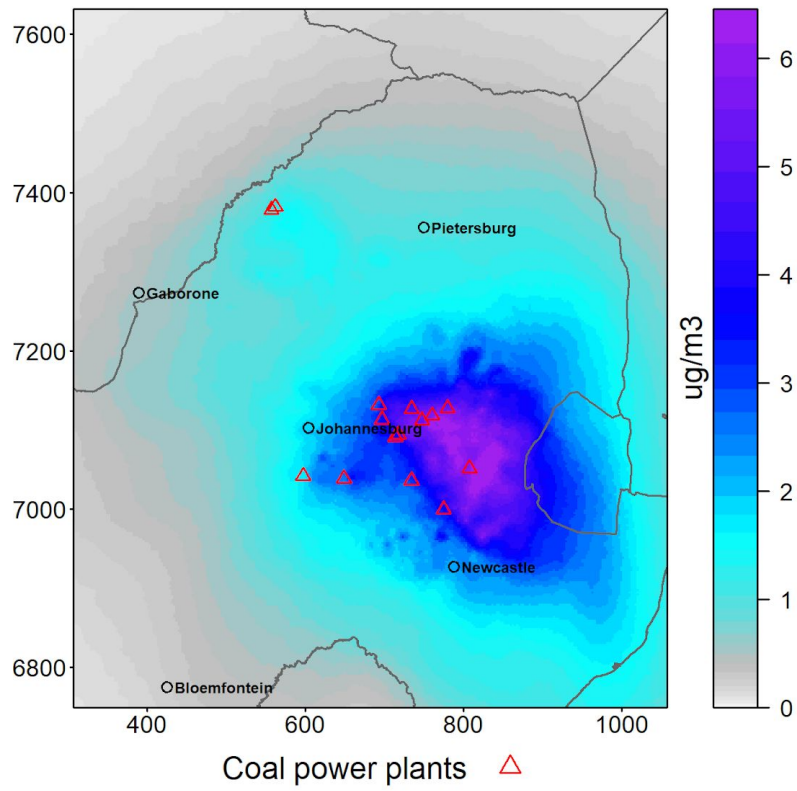

Annual total mercury deposition from all Eskom coal plants

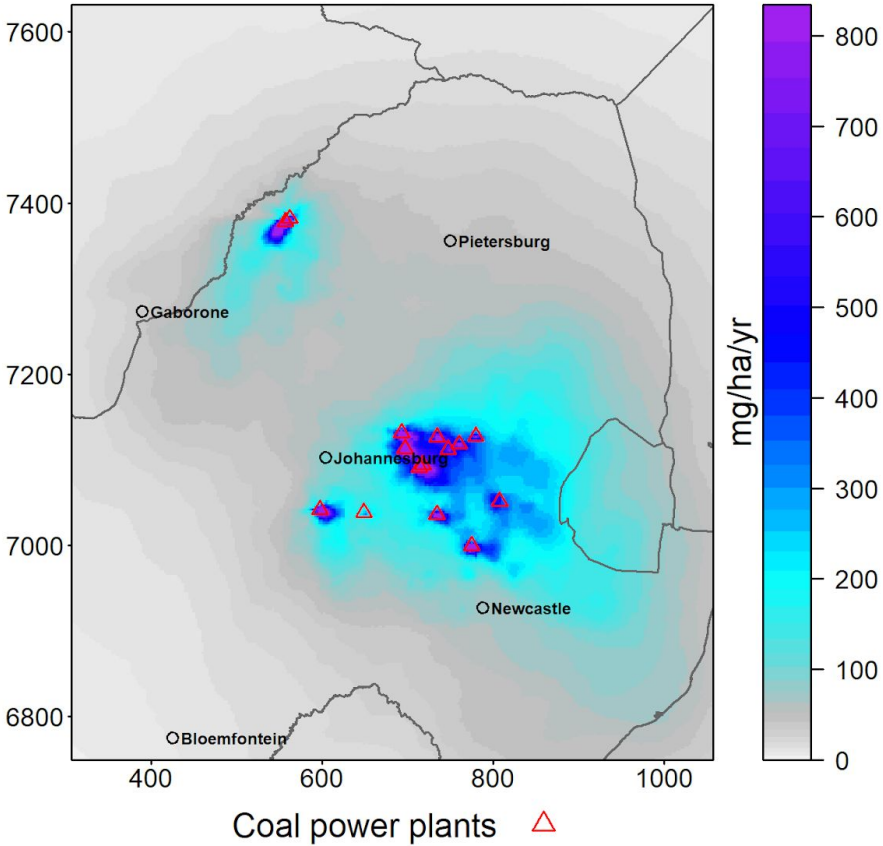

Health impacts: The health impacts of the changes in air quality are quantified using the Global Burden of Disease methodology for PM2.5, and WHO recommendations for NO2.

Projected health impacts of Eskom's emissions in the current situation, after under construction plants are commissioned

Pollutant	Cause of death	Premature deaths		
		Central	Low	High
PM2.5	Lower respiratory infections	826	757	877
PM2.5	Chronic obstructive pulmonary disease	208	167	215
PM2.5	Diabetes	151	50	169
PM2.5	Ischemic heart disease	255	214	268
PM2.5	Lung cancer	123	101	141
PM2.5	Stroke	137	80	155
NO2	All causes	373	205	541
All	Total	2074	1574	2366

Projected health impacts of Eskom's emissions in the current situation, in Gauteng by municipality

Cause of death	Pollutant	City of Johannesburg	City of Tshwane	Ekurhuleni	Sedibeng	West Rand	Total
Lower respiratory infections	PM2.5	43 (38-47)	40 (38-42)	34 (31-38)	6 (5-7)	7 (7-8)	130 (120-141)
Chronic obstructive pulmonary disease	PM2.5	14 (13-15)	13 (12-13)	11 (10-12)	2 (2-2)	2 (2-2)	43 (39-44)
Diabetes	PM2.5	3 (2-5)	4 (4-5)	2 (2-4)	0 (0-1)	1 (0-1)	10 (9-15)
Ischemic heart disease	PM2.5	16 (15-16)	15 (14-15)	13 (12-13)	2 (2-2)	3 (2-3)	49 (45-50)
Lung cancer	PM2.5	11 (10-11)	9 (8-10)	8 (8-9)	2 (1-2)	2 (2-2)	32 (28-34)
Stroke	PM2.5	8 (6-9)	8 (5-8)	7 (5-7)	1 (1-1)	1 (1-1)	25 (17-27)

All causes	NO2	46 (25-67)	29 (16-43)	42 (23-60)	8 (4-11)	6 (4-9)	132 (72-191)
Total		142 (109-170)	118 (97-136)	118 (90-143)	22 (16-26)	22 (18-27)	421 (330-501)

Projected cumulative health impacts of excess emissions from Eskom's proposed non-compliance with the MES

Pollutant	Cause of death	Premature deaths		
		Central	Low	High
PM2.5	Lower respiratory infections	5594	5134	5934
PM2.5	Chronic obstructive pulmonary disease	2346	1894	2427
PM2.5	Diabetes	1458	487	1626
PM2.5	Ischemic heart disease	2986	2505	3131
PM2.5	Lung cancer	1901	1553	2168
NO2	Stroke	1529	897	1727
All	All causes	453	249	657
	Total	16267	12720	17671

Projected cumulative health impacts of excess emissions from Eskom's proposed non-compliance with the MES, in Gauteng by municipality

Cause of death	Pollutant	City of Johannesburg	City of Tshwane	Ekurhuleni	Sedibeng	West Rand	Total
Lower respiratory infections	PM2.5	287 (255-311)	263 (254-278)	221 (199-242)	41 (35-44)	48 (46-54)	860 (789-929)
Chronic obstructive pulmonary disease	PM2.5	168 (154-173)	151 (137-157)	130 (118-133)	22 (22-24)	29 (26-29)	500 (457-516)
Diabetes	PM2.5	32 (23-53)	40 (36-49)	25 (20-41)	4 (3-7)	5 (5-9)	107 (87-159)
Ischemic heart disease	PM2.5	202 (182-203)	183 (166-184)	155 (140-156)	29 (26-29)	34 (30-34)	603 (544-606)
Lung cancer	PM2.5	170 (154-180)	151 (133-161)	130 (118-138)	24 (22-25)	28 (26-30)	504 (452-535)
Stroke	PM2.5	99 (69-104)	90 (61-94)	76 (53-80)	14 (10-15)	17 (11-17)	296 (203-310)
All causes	NO2	67 (37-98)	34 (19-49)	65 (36-95)	14 (8-20)	8 (4-11)	188 (104-273)
Total		1026 (874-1122)	911 (804-973)	803 (683-884)	148 (126-164)	169 (148-184)	3058 (2635-3328)

Modeled mercury deposition in 2017 by land use type, kg/yr

Land use type	Deposition
cropland	350
forest	340
fresh water	18
other	146
shrub and grassland	1398
sea	236

Materials and methods

Emissions projections

To model the current situation, annual air pollutant emissions are compiled from Eskom's Annual Emissions Reports and emissions data reported in Eskom's MES postponement applications. For Medupi and Kusile, annual emissions are taken from their Environmental Impact Statements, except Kusile SO₂ emissions are calculated based on stated emissions without flue gas desulfurization and the reported 93% SO₂ removal efficiency in performance tests¹.

Emissions of SO₂, NO_x and PM in the scenarios are estimated based on reported current annual emissions and current emission limits. In cases where an alternative emission limit is requested until 2020, and this limit is higher than the current limit, the alternative limit is assumed to be representative of current emission control performance. Annual emissions under new, stricter emissions limits are calculated as:

$$[\text{current annual emissions}] * [\text{new emission limit}] / [\text{current emission limit}]$$

The rationale for this calculation is that average pollutant flue gas concentrations have to be significantly below the emission limit value in order to ensure emission limits are consistently met. The ratio of average emission values and emission limit is assumed to stay the same when a new emission limit is applied. In reality, given that the MES are extremely lax in international comparison, retrofits are likely to result in significantly lower emissions rates than required by the standards, making the calculation conservative.

The operating rates of each power plant are assumed to stay constant over time. This is another potentially conservative assumption, as operating rates would seem likely to increase substantially in 2030s when a large number of older existing units retire. This would result in higher emissions from the remaining units.

¹<https://www.powermag.com/press-releases/eskoms-kusile-wet-flue-gas-desulphurization-plant-achieves-93-removal-efficiency-rate-upon-completion-and-performance-test-evaluation/>

Properties of modeled stacks

Power station	Stack	Stack height, m	Effective stack diameter, m	Lat UTM	Lon UTM	Stack exit temperature (°C)	Stack exit velocity, m/s
Arnot	1	193	11	779.601	7127.669	145	27.5
Arnot	2	193	11	779.631	7127.459	145	27.5
Camden	1	154.5	8.74	807.5673	7051.729	150	10
Camden	2	154.5	8.74	807.6571	7051.745	150	10
Camden	3	154.5	8.74	807.737	7051.76	150	10
Camden	4	154.5	8.74	807.836	7051.78	150	10
Duvha	1	300	12.47	734.213	7126.385	120	23.2
Duvha	2	300	12.47	734.308	7126.612	120	23.2
Grootvlei	1	152	8.99	648.888	7038.364	140	19.57
Grootvlei	2	152	8.99	648.924	7038.251	140	19.57
Hendrina	1	155.5	11.14	760.383	7118.306	128	15.4
Hendrina	2	155.5	11.14	760.304	7118.047	128	15.4
Kendal	1	210	13.51	696.808	7112.86	125	27
Kendal	2	210	13.51	697.053	7112.786	125	27
Kriel	1	213	14.3	717.541	7094.474	130	17
Kriel	2	213	14.3	717.645	7094.275	130	17
Komati	1	220	8	747.225	7112.052	150	24
Komati	2	220	8	747.348	7111.997	145	24
Lethabo	1	275	13.34	597.261	7041.798	145	24.7
Lethabo	2	275	13.34	597.029	7041.693	145	24.7
Majuba	1	250	12.3	774.816	6999.525	125	22
Majuba	2	250	12.3	774.683	6999.307	125	22
Matimba	1	250	12.82	562.317	7382.199	127.5	22.5
Matimba	2	250	12.82	562.259	7382.446	127.5	22.5
Matla	1	213	14.3	713.89	7091.286	138	24
Matla	2	275	12.47	713.785	7091.519	138	24
Medupi	1	220	15.58846	557.231	7378.553	140	18
Medupi	2	220	15.58846	557.271	7378.342	140	18
Tutuka	1	275	12.3	733.759	7036.088	135	35
Tutuka	2	275	12.3	733.999	7036.106	135	35
Kusile	1	250	15.58846	692.3035	7132.023	80	18
Kusile	2	250	15.58846	692.0672	7131.792	80	18

Modeled emissions in the 'current situation', tonnes per year

Power station	Stack	NOX	SO2	PM
Arnot	1	22864	32406	768
Arnot	2	22864	32406	768
Camden	1	9656	17443	290
Camden	2	9656	17443	290
Camden	3	9656	17443	290
Camden	4	9656	17443	290
Duvha	1	31992	62346	2134
Duvha	2	31992	62346	2134
Grootvlei	1	12376	23939	4084
Grootvlei	2	12376	23929	4084
Hendrina	1	18231	42531	469
Hendrina	2	19751	46177	469
Kendal	1	37967	115019	4591
Kendal	2	37967	92015	4591
Kriel	1	44653	60937	4786
Kriel	2	44653	60937	4786
Komati	1	54179	76910	3326
Komati	2	54179	76910	3326
Lethabo	1	47927	89690	4718
Lethabo	2	47927	89690	4718
Majuba	1	62705	78030	1104
Majuba	2	62705	78030	1104
Matimba	1	33796	154631	2452
Matimba	2	33796	154631	2452
Matla	1	54179	76910	4390.32
Matla	2	54179	76910	2195.16
Medupi	1	35336	205333	215
Medupi	2	35336	205333	2150
Tutuka	1	47166	80108	8581
Tutuka	2	47166	80108	8581
Kusile	1	38827	11327	3532
Kusile	2	38827	11327	3532

The new South African emission control requirements would have significant ancillary mercury control benefits, and hence the failure by Eskom to install the required emission controls would lead to higher mercury emissions than in the case of full compliance.

As Eskom has neglected to report mercury emissions, these are estimated based on UNEP 2009. Meeting the New Source MES is assumed to require the installation of FGDs but not SCRs at all units. Resulting reductions in mercury emissions are estimated based on UNEP 2017.

Mercury removal rates assumed for different air pollution control technologies.

ESP	30%
Fabric filter	50%
Fabric filter + FGD	70%

Atmospheric modeling

Atmospheric dispersion modeling for the study was carried out using version 7 (June 2015) of the CALPUFF modeling system. CALPUFF is an advanced non-steady-state meteorological and air quality modeling system adopted by the U.S. Environmental Protection Agency (USEPA) in its Guideline on Air Quality Models as the preferred model for assessing long range transport of pollutants and their impacts.

Meteorological data for the simulations was generated by combining two sources: hourly observations from 18 meteorological stations in South Africa and neighboring countries, and prognostic 3-dimensional weather fields generated using the TAPM modeling system, developed by Australia's national science agency CSIRO, and also used for Eskom's own cost-benefit study. TAPM uses as its inputs global weather data from the GASP model of the Australian Bureau of Meteorology, combined with higher-resolution terrain data. TAPM outputs were converted into formats accepted by CALPUFF's meteorological preprocessor, CALMET, using the CALTAPM utility, and the meteorological data were then prepared for CALPUFF execution using CALMET. CALMET generates a set of time-varying micrometeorological parameters (hourly 3-dimensional temperature fields, and hourly gridded stability class, surface friction velocity, mixing height, Monin-Obukhov length, convective velocity scale, air density, short-wave solar radiation, surface relative humidity and temperature, precipitation code, and precipitation rate) for input to CALPUFF.

Terrain height and land-use data were also prepared using the TAPM system and global datasets made available by CSIRO. Two sets of nested grids with a 50x50 grid size and 30km, 10km and 5km horizontal resolutions and 12 vertical levels was used, centered on Highveld and Limpopo.

30% of emitted fly ash was assumed to be PM_{2.5}, and 67.5% PM₁₀, in line with the U.S. EPA (1998) default value for electrostatic precipitators. Particulate matter larger than 10 microns were modeled with a mean aerodynamic diameter of 15 microns. Reported annual emissions were converted into hourly emission rates using monthly and diurnal emissions profiles reported by Eskom.

For modeling mercury, the recommended parameter values from EPA (1997) were adopted. Mercury speciation was based on Lee et al. (2006).

Chemical transformation of sulphur and nitrogen species was modeled using the ISORROPIA/RIVAD chemistry module within CALPUFF. The chemical reaction set requires background pollutant concentration parameters (ozone, ammonia and H₂O₂ levels). For ozone, monitoring data for 2017 was available for 11 stations within the modeling domain. Monthly average background ammonia levels were obtained from a study by North-West university (Martins et al 2007).

As H₂O₂ data was not available, the U.S. EPA default (1ppb) was used, and a sensitivity test was carried out to ensure the results are not sensitive to this assumption by repeating one of the simulations with an 80% lower value; resulting average PM_{2.5} concentrations were 5% lower due to less secondary particle formation, showing that this parameter was not a significant source of uncertainty.

The CALPUFF results were reprocessed using the POSTUTIL utility to repartition different nitrogen species (NO, NO₂, NO₃ and HNO₃) based on background ammonia concentrations.

Health impact assessment

The health impacts of the changes in ambient air pollution concentrations were assessed following the Global Burden of Disease methodology. The basic foundation for the health impact estimates are numeric scientific studies that show that the risk of chronic diseases such as stroke and lung cancer is increased for people who live in areas with higher PM_{2.5} levels. The Global Burden of Disease project has developed “integrated risk functions” that combine studies covering a very wide range of PM_{2.5} exposure levels and thereby avoid extrapolating epidemiological results beyond the concentration range in which they were obtained.

The implementation of the GBD methodology followed two steps: first, reproduction of the GBD results for total mortality related to PM_{2.5} for each grid cell, and second, modifying the PM_{2.5} concentration to remove the contribution from Eskom power plants, and calculating the change in health impacts.

Health impact assessment was implemented in a 1x1km grid, with atmospheric modeling results interpolated linearly and population data aggregated to the grid. Premature deaths in a given grid cell are calculated as

$Pd = PAF * DR * pop * AF$, and

$PAF(conc) = 1 - 1 / RR(conc)$,

in which $RR(conc)$ is the cause-specific risk ratio for the average PM_{2.5} concentration $conc$ in the grid cell, based on the non-linear concentration-response function RR integrated for the GBD project from dozens of epidemiological studies in Stanaway et al (2018). PAF is the population attributable fraction, share of deaths from cause c in the relevant age group that are attributable to PM_{2.5} exposure, DR is the baseline death rate from cause c in the relevant age group, pop is the total population in the grid cell, and age fraction AF is the fraction of population that belongs to the relevant age group (25 years and above for chronic diseases and under 5 years for Acute Respiratory Infections).

Given baseline mean PM2.5 concentration $\text{conc}_{\text{base}}$, and concentration attributed to the modeled coal-fired power plants $\text{conc}_{\text{coal}}$, the PAF for the coal plants specifically is obtained as:

$$\text{PAF}_{\text{coal}} = \text{PAF}(\text{conc}_{\text{base}}) - \text{PAF}(\text{conc}_{\text{base}} - \text{conc}_{\text{coal}})$$

Put another way, PAF_{coal} is the projected reduction in mortality from a specific cause if the modeled power plant emissions are completely eliminated.

For stroke and ischaemic heart disease, the GBD concentration-response functions are age-specific. Appropriate functions for the entire South African adult population are derived as averages of the age-specific functions weighted by the population share of each age group in South Africa.

To get baseline PM2.5 concentrations we used global gridded PM2.5 data for 2016 derived by combining available ground-level measurements with satellite-based aerosol retrievals and atmospheric model outputs (van Donkelaar et al 2016). Using 2016 baseline concentrations as the basis for future impacts can be seen as conservative, if overall air quality is likely to improve in the future, which would increase the health impacts attributed to the power plants due to the concave shape of the risk functions.

To further apportion the health impacts to individual power plants, the share of total mortality in a given grid cell attributed to emissions of species s from power plant i was calculated as:

$$\text{PAF}_{i,s} = \text{PAF}_{\text{coal}} \times \text{conc}_{i,s} / \text{conc}_{\text{coal}}$$

where $\text{conc}_{i,s}$ is the modeled PM2.5 concentration at the given grid cell that is attributable to emissions of s from the power plant i . Apportionment was done linearly rather than using the non-linear function as otherwise results would depend on the order in which impacts are apportioned to different power plants. Obtaining the $\text{PAF}_{i,s}$ values for each power plant, pollutant and grid cell enabled us to project the impacts of changes in emissions by scaling each value in proportion to changes in emissions.

For stroke and IHD, the RR function is derived separately for different age groups, at 5-year intervals. The appropriate aggregate RR functions were derived as the mean of age-specific RR function values at each concentration level, weighted by the share of the age group in total cause-specific mortality.


In addition, to PM2.5 health impacts, premature deaths from NO2 exposure were assessed using the risk ratio for daily mortality based on WHO (2013) recommendations, from Mills et al (2016). This choice of risk ratio is conservative as it only includes the short-term effects of PM2.5 exposure; including chronic effects could result in almost 10 times as high current health impact. However, the effect on projected health impacts of “excess emissions” would be small as these are dominated by the health impacts of excess SO2 emissions.

We obtained current death rates by cause and by country from Global Burden of Disease data (IHME 2018). The projections take into account expected population growth and epidemiological transition associated with improved health care and aging population. High-resolution spatial distribution of

population from NASA SEDAC (CIESIN 2018) was used. Birth rates and incidence of low birth weight were obtained from World Bank (undated).

For future projections of health impacts, population growth is assumed to follow the UNPD 'Medium variant'. Incidence of different causes of death in 2015 is based on WHO Global Health Estimates (2018). For future incidence, the change projected GHE for sub-Saharan Africa is used to adjust the incidences, entailing reductions in baseline child mortality from Lower Respiratory Infections and increases in chronic cardiovascular diseases and cancers for adults.

Concentration-response functions developed for the Global Burden of Disease study and applied to assessing the health impacts.

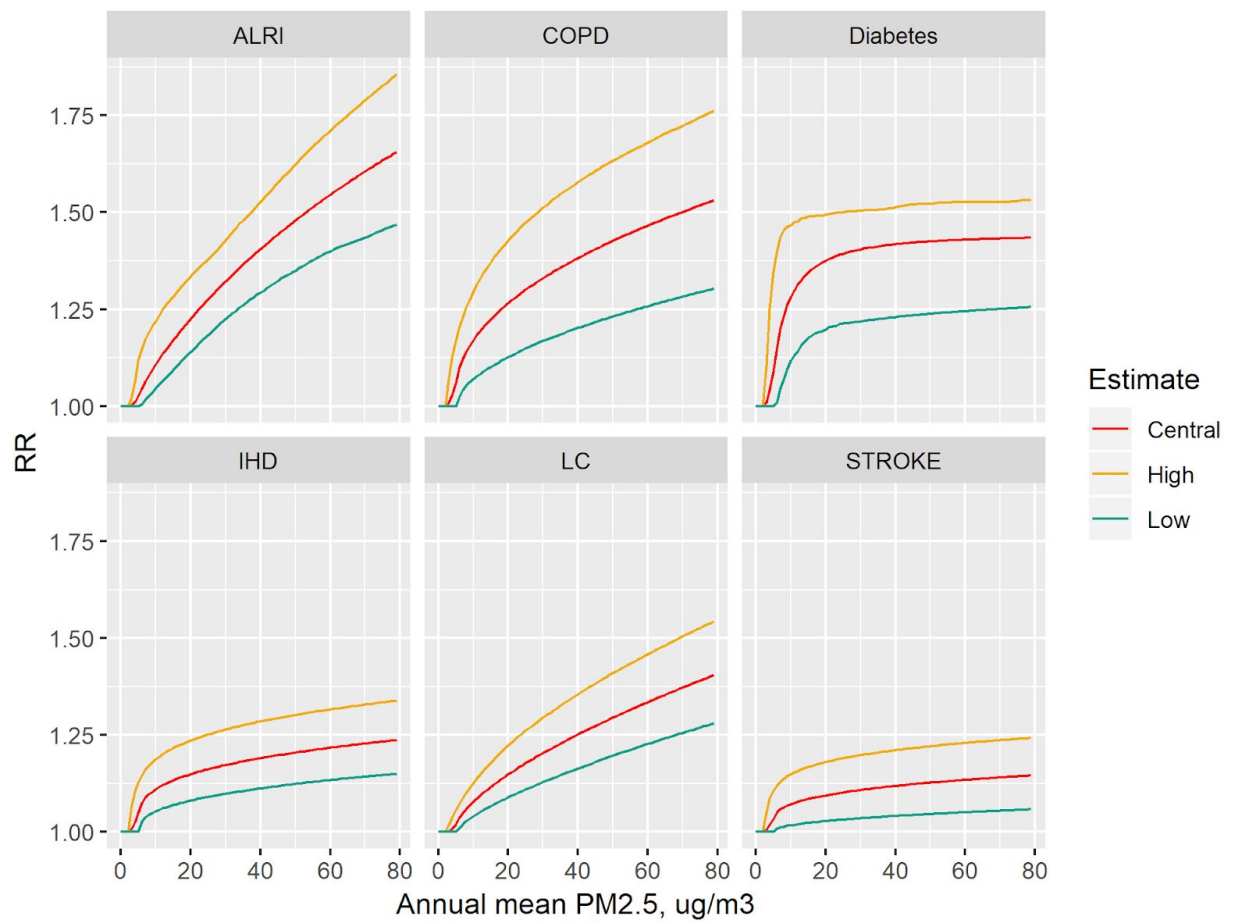

Additional risk ratios used for health impact assessment

Risk ratio for 10µg/m³ increase in exposure (Pollutant)	Central	95% CI, low	95% CI, high	Reference
Deaths, all causes (NO₂)	1.0060	1.0033	1.0087	Mills et al 2016

Deposition results were differentiated by land use type using the European Space Agency global land use map for the year 2015 at 300m resolution (ESA 2018; see Figure 12). Land use codes 10-30 were mapped as cropland; codes 50-100 and 160-170 were mapped as forest.

References

- CIESIN, FAO and CIAT 2016: Gridded Population of the World, Version 4 (GPWv4): Population Count. Palisades, NY: NASA Socioeconomic Data and Applications Center (SEDAC).
<http://dx.doi.org/10.7927/H4X63JVC>
- EPA, 1997. Mercury Study-Report to Congress, Volume III: Fate and Transport of Mercury in the Environment. EPA-452/R-97-005, December 1997.
- van Donkelaar et al 2016: Global Estimates of Fine Particulate Matter using a Combined Geophysical-Statistical Method with Information from Satellites, Models, and Monitors, Environ. Sci. Technol, doi: <http://dx.doi.org/10.1021/acs.est.5b05833>
- Institute for Health Metrics and Evaluation (IHME), 2018. Global Burden of Disease Study 2017 (GBD 2017) Results. Seattle, United States. <http://ghdx.healthdata.org/gbd-results-tool>
- Langerman KE and Pauw CJ, 2018. A critical review of health risk assessments of exposure to emissions from coal-fired power stations in South Africa. Clean Air Journal 28(2):68 - 79.
<https://journals.co.za/content/journal/10520/EJC-1324683d18>
- Lee SJ, Seo YC, Jang HN, Park KS, Baek JI, An HS, Song KS, 2006. Speciation and mass distribution of mercury in a bituminous coal-fired power plant. Atmospheric Environment 40:2215–2224.
- Martins JJ et al, 2007. Long-term measurements of sulphur dioxide, nitrogen dioxide, ammonia, nitric acid and ozone in southern Africa using passive samplers. South African Journal of Science.
http://www.scielo.org.za/scielo.php?script=sci_arttext&pid=S0038-23532007000400018
- Mills IC, Atkinson RW, Anderson HR, et al, 2016. Distinguishing the associations between daily mortality and hospital admissions and nitrogen dioxide from those of particulate matter: a systematic review and meta-analysis. BMJ Open 6:e010751. <http://dx.doi.org/10.1136/bmjopen-2015-010751>
- Myllyvirta L, 2014. Health impacts and social costs of Eskom’s proposed non-compliance with South Africa’s air emission standards. Greenpeace International.
https://cer.org.za/wp-content/uploads/2014/02/Annexure-5_Health-impacts-of-Eskom-applications-2014-final.pdf
- Stanaway JD et al., 2018. Global, regional, and national comparative risk assessment of 84 behavioural, environmental and occupational, and metabolic risks or clusters of risks for 195 countries and territories, 1990–2017: a systematic analysis for the Global Burden of Disease Study 2017. Lancet 392(10159):1923-1994. [https://doi.org/10.1016/S0140-6736\(18\)32225-6](https://doi.org/10.1016/S0140-6736(18)32225-6)
- Swain EB et al, 1992. Increasing Rates of Atmospheric Mercury Deposition in Midcontinental North America. Science 257:784-787.
- UN DESA, 2017. World Population Prospects 2017. <https://population.un.org/wpp/>

UNEP, 2017. Toolkit for Identification and Quantification of Mercury Releases. UN Environment Chemicals Branch, Geneva, Switzerland.

World Bank. World Development Indicators. <http://databank.worldbank.org/data/home.aspx>

World Health Organization (WHO), 2013. Health risks of air pollution in Europe - HRAPIE project. http://www.euro.who.int/__data/assets/pdf_file/0017/234026/e96933.pdf?ua=1

WHO, 2018: UPDATED WHO PROJECTIONS OF MORTALITY AND CAUSES OF DEATH 2016-2060. https://www.who.int/healthinfo/global_burden_disease/projections/en/